

1 LEVEL 01 - HVAC  
M201 1/4" = 1'-0"


**GENERAL SHEET NOTES:**

- A. PROVIDE REMOTE ACTUATORS FOR ALL INACCESSIBLE VOLUME DAMPERS.
- B. REFER TO ARCHITECTURE REFLECTED CEILING PLANS FOR EXACT CEILING DIFFUSER AND GRILLE LOCATIONS.
- C. MOTORIZED DAMPERS AT INTAKE AND EXHAUST LOUVERS TO HAVE MAXIMUM 10 CFM/SF LEAKAGE AT 1.0 INWG.



ARCHITECTURE  
URBAN DESIGN + PLANNING  
INTERIOR DESIGN

PORTLAND | OAKLAND  
SERADESIGN.COM

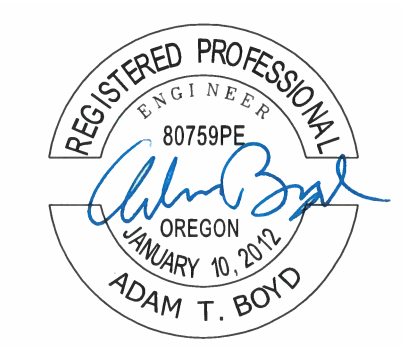

EXP. 12-31-21

**COLEBREIT**  
ENGINEERING  
721 SW INDUSTRIAL WAY | SUITE 110 | BEND OR 97702  
541.728.3293 | COLEBREIT.COM

**OMD ENLISTED BARRACKS EB4**

OREGON MILITARY  
7000 CHRYSLER ROAD  
HERMISTON, OREGON 97838

REVISIONS  
A ADDENDUM 'A' 13 AUG. 2021

CHECKED BY: AB  
ISSUE DATE: 30 JULY 2021  
PROJECT NO: 269.005

MECHANICAL -  
LEVEL 01 - HVAC  
**M201**

PERMIT / BID SET